


Meeting Stile

Smoke-Rated Astragal Sets

Fire-rated Astragal Seals cannot replace any astragal required on the door by the door manufacturer to maintain its fire label. IBC, NFPA 80, NFPA105, NFPA 252 require the gap at the meeting edge between fire labeled doors must not exceed 1/8".

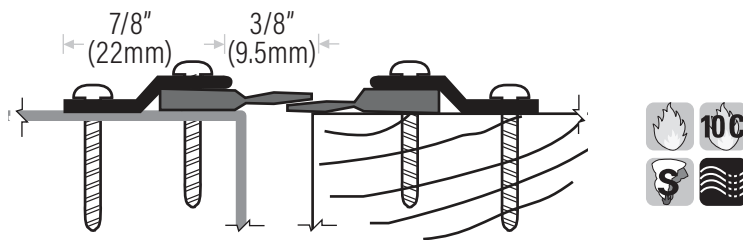

DS147CN Extruded aluminum clear anodized with neoprene insert.
Sold in single units, order 2 lengths for meeting stile.

Meeting stile is supplied with punched holes and screws and is available in the following NET lengths:
84" (2134mm) & 96" (2438mm). Custom lengths available, call for manufacturing time.